



February 19, 2018

ISSUED FOR USE FILE: 704-ENW.VENW03150-01 Via Email: BHackwood@sd68.bc.ca

School District 68 (Nanaimo-Ladysmith) 395 Wakesiah Road Nanaimo, BC V9R 3K6

Attention: Brian Hackwood, Maintenance Manager

Subject: Domestic Water Testing (Lead) Inventory – Park Avenue Elementary School

# 1.0 INTRODUCTION

Tetra Tech Canada Inc. (Tetra Tech) was retained School District 68 Nanaimo-Ladysmith (SD 68) to conduct a domestic water testing inventory at Park Avenue Elementary School located in SD 68. Tetra Tech understands that the BC Ministry of Education has issued a directive to protect drinking water. The directive requires that a systematic investigation of public drinking water supplies at select schools in the District be undertaken. The investigation is based on procedures set forth by Health Canada modified per the Vancouver Island Health Authority (VIHA) guidelines, to ascertain risk and mitigation.

Tetra Tech understands that the sampling schedule, collection, testing and reporting of results needs to be completed by March 1, 2018 in order to allow sufficient time for SD 68 to implement mitigation measures prior to its deadline of March 31, 2018.

Mr. Brian Hackwood, Maintenance Manager with SD 68, provided Tetra Tech with authorization to proceed with the inventory on January 18, 2018.

## 2.0 METHODOLOGY

Tetra Tech completed the domestic water testing inventory program at Park Avenue Elementary School on January 29<sup>th</sup>, 2018. The 2018 sampling program was conducted as per the protocols established during the 2016 program. The methodologies employed during the field program are detailed in the following subsections.

# 2.1 Sampling Locations

Tetra Tech reviewed plans for the facility prior to commencing the field work to identify potential sampling locations. The facility was then assessed in the field and sampling locations were selected based on the probability of human consumption at a location. The sampling locations included one point that was closest to the location where the water supply enters the building, one that is the furthest point from where the water supply enters the building and from points where human consumption of water occurred or was reasonably likely to occur. The sampling locations for Park Avenue Elementary School are shown on the attached Figure 1.

Hallway drinking fountains and kitchen sinks were all considered to have a high probability of human consumption of water and were always sampled. Sinks with visible evidence of human consumption of water, such as water bottles, cups, or electric kettles were also considered to have a high probability of human consumption of water and were sampled. Although classroom sinks (including those with water fountains) were considered to have a moderate to high probability of human consumption of water, only representative samples were collected as per the direction



of SD 68 Maintenance Manager, Mr. Brian Hackwood. Classroom laboratory and art room sinks, where present, were considered to have a low probability of human consumption of water so only representative samples were collected. Finally, washrooms and utility sinks, unless there was other evidence of human consumption of water (such as an electric kettle) were considered to be a low probability of human consumption of water and only representative samples were collected.

# 2.2 Drinking Water Sampling

Sampling was conducted in the early hours of Monday, January 29<sup>th</sup>, 2018 in order collect water samples representative of an approximate worse-case scenario of water that had remained in contact with the school's plumbing over the course of a weekend. Two samples were collected at each sample location; the first collected immediately prior to any water line flushing (0 second sample); the second collected after thirty seconds of water line flushing (30 second sample).

The process for the sequence of analysis for a sample location is as follows:

- Only the pre-flush (0 second) sample is initially submitted for laboratory analysis;
- If the analytical result exceeds the *Guidelines for Canadian Drinking Water Quality* (GCDQG) Maximum Allowable Concentration (MAC), the 30 second sample would be submitted for further analysis; and
- If the 30 second sample analytical result exceeds the GCDQG MAC, additional samples would be collected
  after flushing with cold water for 2 minutes and 5 minutes at a subsequent sampling event and both samples
  submitted for analysis.

Water samples were collected directly from the sample point into clean, labeled, new laboratory-supplied containers. After collecting the water, each sample then had preservative added for total lead. Sampling personnel wore new nitrile gloves prior to collecting each sample. Samples were kept in a cooler with ice after collection until being brought back to Tetra Tech's Nanaimo office, where samples not immediately submitted to the laboratory were stored in refrigerated conditions.

# 2.3 Analytical Testing

Samples were analyzed by Maxxam Analytics in Burnaby, British Columbia. Maxxam is a Canadian Association for Laboratory Accreditation (CALA) accredited laboratory that is qualified to analyze the samples using British Columbia Ministry of Environment (MOE)-approved procedures. All water samples submitted were analyzed for total lead.

# 2.4 Quality Assurance / Quality Control

During the sampling program, Tetra Tech implemented a Quality Assurance/Quality Control (QA/QC) program to ensure the integrity of the sampling methodology and analytical testing. The QA/QC program adhered to Tetra Tech's in-house Quality Management System (QMS), which was designed to generate representative samples, minimize the potential for cross-contamination between sampling locations and samples, and reduce the potential for systematic bias.

The QA/QC program included the following tasks:

- Recording the results of field activities in the field concurrently with the activities;
- Use of clean, new sampling gloves at each sampling location;





- Placing samples into new, labeled laboratory-supplied containers;
- Transporting samples to Maxxam in chilled coolers using chain-of-custody procedures;
- Using a Canadian Association for Laboratory Accreditation (CALA) accredited laboratory that is qualified to analyze the samples using MOE-approved procedures;
- Independently verifying the sample concentrations flagged by Maxxam as being greater than Health Canada guidelines by uploading laboratory results using ESdat, an environmental data management software, to minimize transcription errors; and
- Conducting a review of this report by a qualified senior Tetra Tech professional to ensure that the report meets
   Tetra Tech technical and reporting requirements.

### **Laboratory Quality Assurance / Quality Control Program**

Water samples were submitted to Maxxam, a CALA accredited laboratory. Laboratory testing was conducted using methods outlined in the British Columbia Environmental Laboratory Manual. Laboratory QA/QC reports are attached to the laboratory reports presented in Appendix B. Samples included in the QA/QC reports consist of laboratory batches and will include random samples from the lab report and potentially other projects to complete a batch.

The Laboratories will note any sample deficiencies, such as unacceptable headspace, broken jars or bottles, etc. As well, the laboratory will measure the temperature of samples received by the laboratory in Burnaby.

### **Duplicate Sample – Relative Percent Difference (RPD)**

A second aliquot is obtained from a randomly chosen sample. The aliquot is processed and the results expressed as the RPD between the two results. The purpose of the laboratory duplicate is to evaluate analytical precision and sample homogeneity. Tetra Tech formed the duplicate samples by alternately placing approximately 10% of the sample volume into the original sample container and then placing the same amount into the duplicate sample container. Tetra Tech continued placing additional aliquots of approximately 10% of the sample volume into each container until both containers were filled. RPDs should only be calculated and assessed when both the sample and the duplicate concentration is greater than five times the reportable detection limit (RDL), referred to as the Practical Quantification Limit (PQL).

The RPD calculations are discussed in Section 5.0. At Park Avenue Elementary School, duplicate samples PADUP-0s and PADUP-30s were collected at PA17-0s and PA17-30s respectively.

# 3.0 ASSESSMENT STANDARDS

As per the guidance from the Vancouver Island Health Authority (VIHA), Tetra Tech compared the sample analytical results to the *Guidelines for Canadian Drinking Water Quality* (GCDQG) published by Health Canada, February 2017. The guidelines list a Maximum Acceptable Concentration (MAC) for lead of 0.010 mg/L (10 µg/L). The MAC for lead is based on chronic effects and is intended to apply to average concentrations in water consumed for extended periods. No immediately toxic concentration for lead is listed, however exposure to lead should nevertheless be kept to a minimum.





# 4.0 ANALYTICAL RESULTS

Tetra Tech collected water samples from Park Avenue Elementary School on January 29<sup>th</sup>, 2018. A total of 17 sample locations were identified; two samples were collected at each location (i.e., 0 second sample and 30 second sample). Seventeen (17) pre-flush (0 second) samples (plus one pre-flush duplicate) were submitted for laboratory analysis of total lead.

# Seven of the locations had 0 second samples containing concentrations of total lead greater than the GCDWQ MAC.

Sample PA01 was collected from the sink in Classroom 207, PA02 was collected from the gymnasium kitchen sink, PA03 was collected from the drinking water fountain outside the gymnasium, PA07 was collected from a drinking fountain in the sink in classroom 203, PA11 was collected from the sink in the library office, PA16 was collected from the drinking fountain in the sink in the counselling conference room 108, and PA17 (and the duplicate sample) was collected from the drinking fountain in the sink in classroom 114. The 30 second sample for all these locations was submitted for laboratory analysis of total lead.

# The 30 second samples at all tested locations contained concentrations of total lead less than the GCDWQ MAC.

Sampling locations are shown on Figure 1. Laboratory testing results for Park Avenue Elementary School are summarized in the table below. The complete laboratory certificate is provided as Appendix B with Park Avenue Elementary School results found on included on Maxxam lab report R2510628 pages 4-5 and Maxxam lab report R2513683 page 3.

**Table 1: Laboratory Testing Results** 

Sample ID	Sample Date	MAC	Total Lead (µg/L)
	0 Second S	amples	
PA01-0s	1/29/2018		13.7
PA02-0s	1/29/2018		17.3
PA03-0s	1/29/2018		18.7
PA04-0s	1/29/2018		6.60
PA05-0s	1/29/2018		1.20
PA06-0s	1/29/2018		1.41
PA07-0s	1/29/2018		15.0
PA08-0s	1/29/2018		4.33
PA09-0s	1/29/2018	10.00/	3.75
PA010-0s	1/29/2018	— 10 μg/L	1.03
PA011-0s	1/29/2018		30.2
PA012-0s	1/29/2018		3.29
PA013-0s	1/29/2018		3.07
PA014-0s	1/29/2018		4.19
PA015-0s	1/29/2018		5.69
PA016-0s	1/29/2018		17.2
PA017-0s	1/29/2018		65.1
PADUP-0s	1/29/2018		49.3
	30 Second S	amples	
PA01-30s	1/29/2018		3.18
PA02-30s	1/29/2018		7.31



Sample ID	Sample Date	MAC	Total Lead (µg/L)
PA03-30s	1/29/2018		2.93
PA07-30s	1/29/2018		0.79
PA11-30s	1/29/2018	10 μg/L	0.94
PA16-30s	1/29/2018		1.86
PA17-30s	1/29/2018		5.50
PADUP-30s	1/29/2018		5.54
*duplicate sample	s PADUP-0s and PADUP-30s v	vere collected at P	A17-0s and PA17-30s
Notes:	Grey Fill	Exceed	s GCDWQ MAC

# 5.0 DISCUSSION AND RECOMMENDATIONS

Tetra Tech's sampling program was based upon guidance from the Ministry of Health, found in the document *Guidance on Controlling Corrosion in Drinking Water Distribution Systems* (2009). The rationale is that for each sampling point, if the pre-flush (0 second) sample (Tier 1) contained elevated lead concentrations, it could indicate that the faucet or fittings are the likely be the source of lead. If a subsequent 30 second flush sample (Tier 2) contained elevated lead concentrations, the source of the lead would likely be the piping (plumbing) leading to the faucet; whereas low lead concentrations in the 30 second sample would further indicate that the source was likely the faucet and fittings. Finally, a 5 minute flush sample (if required) should be drawing water directly from the water supply piping within the building and would indicate if flushing is feasible for lowering the lead concentration in water within the building.

The Health Canada guidance recommend that Tier 2 sampling (30 second samples) take place when Tier 1 sampling identifies more than 10% of sites with lead concentrations above the MAC, and then only at the 10% of sampling sites with the highest lead concentration. Rather, Tetra Tech ran every 30 second sample for locations where the 0 second sample was above the MAC to show that flushing was adequate to lower the lead concentration in the drinking water at each point of concern.

The guidance from the Ministry of Health recommended that samples be collected after the sampling points had been stagnant for a minimum of 8 hours but not longer than 24 hours in order to simulate the worst case daily scenario for lead in drinking water consumption. Based on guidance from VIHA, SD 68 directed Tetra Tech to collect samples Monday mornings prior to any staff or students arriving at the facilities in order to simulate a worst-case scenario for stagnant water. As such, lead concentrations reported represent what could be expected following a weekend and would likely be lower on subsequent weekday mornings.

Seven of the 17 pre-flush (0 second) samples collected at Park Avenue Elementary contained concentrations of lead greater than the GCDWQ MAC. Lead concentrations at sample locations PA01, PA02, PA03, PA07, PA11, PA16 and PA17 exceeded the MAC for the 0 second samples but were below the guideline for the 30 second samples.

As previously noted, where lead concentrations are elevated in 0 second samples, the contributing source is likely the fixture (i.e., faucet or fittings). Since lead concentrations at the locations noted above exceeded the MAC for the 0 second sample but not for the 30 second sample, there is potentially a lead source in the fixture.

Flushing is adequate to lower the lead concentrations at all sample points in Park Avenue Elementary. Signage stating "Water Quality – First thing in the morning... Run the water for two minutes before drinking. Throughout the day... Let the water run until it is cold before drinking" should be maintained throughout the facility at each point where drinking water could be consumed.



At Park Avenue Elementary School, duplicate samples PADUP-0s and PADUP-30s were collected at PA17-0s and PA17-30s respectively. The RPD for the two sample pairs submitted were 27.6% (0 second sample) and 0.7% (30 second sample); which is below the 30% screening threshold as recommended by BC Ministry of Environment Q&A, and BC Environmental Laboratory Manual. Tetra Tech therefore considers the analytical results to be valid and re-sampling not necessary.

# 6.0 SUMMARY AND CONCLUSIONS

Seven pre-flush (0 second) samples (PA01, PA02, PA03, PA07, PA11, PA16 and PA17) collected at Park Avenue Elementary contained concentrations of total lead greater than the GCDWQ MAC of 10µg/L (0.010 mg/L). All of the previously noted samples had concentrations of lead below the MAC in the corresponding 30 second samples.

Tetra Tech recommends that SD 68 continue with its ongoing procedure of conducting a 2 minute flush at each drinking water consumption point each morning; and running taps/faucets until cold prior to consuming water. Signage stating "Water Quality – First thing in the morning... Run the water for two minutes before drinking. Throughout the day... Let the water run until it is cold before drinking" should be maintained at all water consumption points.

Tetra Tech recommends that the facility be inspected on a routine basis to ensure that the above noted signage is present and in good condition at each point where drinking water could be consumed. Tetra Tech further recommends that a bulletin be provided to staff summarizing the drinking water quality results at the facility and reminding them of the above procedure. Staff should then instruct students and visitors in the drinking water procedure.



## 7.0 CLOSURE

This report has been prepared based on the scope of work and for the use of School District 68, which includes distribution as required for the purposes for which this assessment was commissioned. The assessment has been carried out in accordance with generally accepted professional practice. No other warranty is made, either express or implied. Professional judgment has been applied in developing the recommendations in this report.

This report was prepared by personnel with professional experience in investigations of this nature and who specifically conducted the investigations at this Site. Reference should be made to the 'Geoenvironmental Report – Limitations on the Use of this Report' attached in Appendix A that forms a part of this report.

We trust this report meets your present requirements. If you have any questions or comments, please contact the undersigned.

Respectfully submitted, Tetra Tech Canada Inc.

Darren Thomas, B.A.Sc., EIT. Environmental Engineer Environment Practice

Direct Line: 250.756.3966 x229 Darren.Thomas@tetratech.com

Nigel Cavanagh, M.Sc., R.P.Bio., P.Biol.

Senior Aquatic Biologist Environment Practice

Direct Line: 250.756.3966 x240 Nigel.Cavanagh@tetratech.com

/dr

Attachments: Figure 1 - Park Avenue Elementary School Sample Locations

Appendix A - Limitations on the Use of this Document


Appendix B - Laboratory Reports



# **FIGURES**

Figure 1 Park Avenue Elementary School Sample Locations



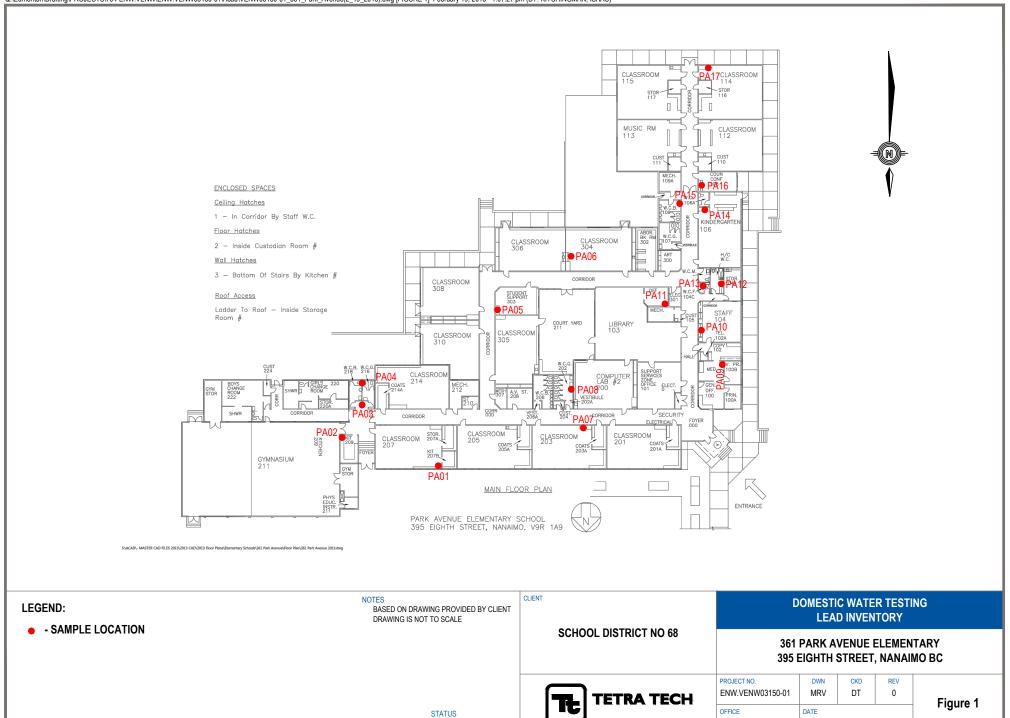

ISSUED FOR REVIEW

EDM

February 1, 2018



# APPENDIX A

# LIMITATIONS ON THE USE OF THIS DOCUMENT



# LIMITATIONS ON USE OF THIS DOCUMENT

### **GEOENVIRONMENTAL**

### 1.1 USE OF DOCUMENT AND OWNERSHIP

This document pertains to a specific site, a specific development, and a specific scope of work. The document may include plans, drawings, profiles and other supporting documents that collectively constitute the document (the "Professional Document").

The Professional Document is intended for the sole use of TETRA TECH's Client (the "Client") as specifically identified in the TETRA TECH Services Agreement or other Contractual Agreement entered into with the Client (either of which is termed the "Contract" herein). TETRA TECH does not accept any responsibility for the accuracy of any of the data, analyses, recommendations or other contents of the Professional Document when it is used or relied upon by any party other than the Client, unless authorized in writing by TETRA TECH.

Any unauthorized use of the Professional Document is at the sole risk of the user. TETRA TECH accepts no responsibility whatsoever for any loss or damage where such loss or damage is alleged to be or, is in fact, caused by the unauthorized use of the Professional Document.

Where TETRA TECH has expressly authorized the use of the Professional Document by a third party (an "Authorized Party"), consideration for such authorization is the Authorized Party's acceptance of these Limitations on Use of this Document as well as any limitations on liability contained in the Contract with the Client (all of which is collectively termed the "Limitations on Liability"). The Authorized Party should carefully review both these Limitations on Use of this Document and the Contract prior to making any use of the Professional Document. Any use made of the Professional Document by an Authorized Party constitutes the Authorized Party's express acceptance of, and agreement to, the Limitations on Liability.

The Professional Document and any other form or type of data or documents generated by TETRA TECH during the performance of the work are TETRA TECH's professional work product and shall remain the copyright property of TETRA TECH.

The Professional Document is subject to copyright and shall not be reproduced either wholly or in part without the prior, written permission of TETRA TECH. Additional copies of the Document, if required, may be obtained upon request.

### 1.2 ALTERNATIVE DOCUMENT FORMAT

Where TETRA TECH submits electronic file and/or hard copy versions of the Professional Document or any drawings or other project-related documents and deliverables (collectively termed TETRA TECH's "Instruments of Professional Service"), only the signed and/or sealed versions shall be considered final. The original signed and/or sealed electronic file and/or hard copy version archived by TETRA TECH shall be deemed to be the original. TETRA TECH will archive a protected digital copy of the original signed and/or sealed version for a period of 10 years.

Both electronic file and/or hard copy versions of TETRA TECH's Instruments of Professional Service shall not, under any circumstances, be altered by any party except TETRA TECH. TETRA TECH's Instruments of Professional Service will be used only and exactly as submitted by TETRA TECH.

Electronic files submitted by TETRA TECH have been prepared and submitted using specific software and hardware systems. TETRA TECH makes no representation about the compatibility of these files with the Client's current or future software and hardware systems.

### 1.3 STANDARD OF CARE

Services performed by TETRA TECH for the Professional Document have been conducted in accordance with the Contract, in a manner

consistent with the level of skill ordinarily exercised by members of the profession currently practicing under similar conditions in the jurisdiction in which the services are provided. Professional judgment has been applied in developing the conclusions and/or recommendations provided in this Professional Document. No warranty or guarantee, express or implied, is made concerning the test results, comments, recommendations, or any other portion of the Professional Document

If any error or omission is detected by the Client or an Authorized Party, the error or omission must be immediately brought to the attention of TETRA TECH.

### 1.4 DISCLOSURE OF INFORMATION BY CLIENT

The Client acknowledges that it has fully cooperated with TETRA TECH with respect to the provision of all available information on the past, present, and proposed conditions on the site, including historical information respecting the use of the site. The Client further acknowledges that in order for TETRA TECH to properly provide the services contracted for in the Contract, TETRA TECH has relied upon the Client with respect to both the full disclosure and accuracy of any such information.

### 1.5 INFORMATION PROVIDED TO TETRA TECH BY OTHERS

During the performance of the work and the preparation of this Professional Document, TETRA TECH may have relied on information provided by persons other than the Client.

While TETRA TECH endeavours to verify the accuracy of such information, TETRA TECH accepts no responsibility for the accuracy or the reliability of such information even where inaccurate or unreliable information impacts any recommendations, design or other deliverables and causes the Client or an Authorized Party loss or damage.

### 1.6 GENERAL LIMITATIONS OF DOCUMENT

This Professional Document is based solely on the conditions presented and the data available to TETRA TECH at the time the data were collected in the field or gathered from available databases.

The Client, and any Authorized Party, acknowledges that the Professional Document is based on limited data and that the conclusions, opinions, and recommendations contained in the Professional Document are the result of the application of professional judgment to such limited data.

The Professional Document is not applicable to any other sites, nor should it be relied upon for types of development other than those to which it refers. Any variation from the site conditions present, or variation in assumed conditions which might form the basis of design or recommendations as outlined in this report, at or on the development proposed as of the date of the Professional Document requires a supplementary investigation and assessment.

TETRA TECH is neither qualified to, nor is it making, any recommendations with respect to the purchase, sale, investment or development of the property, the decisions on which are the sole responsibility of the Client.

### 1.7 NOTIFICATION OF AUTHORITIES

In certain instances, the discovery of hazardous substances or conditions and materials may require that regulatory agencies and other persons be informed and the client agrees that notification to such bodies or persons as required may be done by TETRA TECH in its reasonably exercised discretion.





# APPENDIX B

# LABORATORY REPORT





Your Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Attention: Darren Thomas
TETRA TECH CANADA INC.
#1 - 4376 BOBAN DRIVE
NANAIMO, BC
Canada V9T 6A7

Your C.O.C. #: 546212-05-01, 546212-06-01, 546212-07-01

Report Date: 2018/02/13

Report #: R2513683 Version: 1 - Final

### **CERTIFICATE OF ANALYSIS**

MAXXAM JOB #: B809848 Received: 2018/02/08, 08:40

Sample Matrix: DRINKING WATER

# Samples Received: 26

		Date	Date		
Analyses	Quantity	/ Extracted	Analyzed	Laboratory Method	Analytical Method
Elements by CRC ICPMS (total)	8	N/A	2018/02/09	9 BBY7SOP-00003,	EPA 6020b R2 m
Elements by CRC ICPMS (total)	18	N/A	2018/02/10	) BBY7SOP-00003,	EPA 6020b R2 m

#### Remarks:

Maxxam Analytics' laboratories are accredited to ISO/IEC 17025:2005 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Maxxam are based upon recognized Provincial, Federal or US method compendia such as CCME, MDDELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Maxxam's profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Maxxam in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected.

Maxxam Analytics' liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Maxxam has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Maxxam, unless otherwise agreed in writing.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

\* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.



Your Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

**Attention: Darren Thomas** 

TETRA TECH CANADA INC. #1 - 4376 BOBAN DRIVE NANAIMO, BC Canada V9T 6A7

Your C.O.C. #: 546212-05-01, 546212-06-01, 546212-07-01

Report Date: 2018/02/13

Report #: R2513683 Version: 1 - Final

### **CERTIFICATE OF ANALYSIS**

MAXXAM JOB #: B809848 Received: 2018/02/08, 08:40

**Encryption Key** 

Please direct all questions regarding this Certificate of Analysis to your Project Manager. Letitia Prefontaine, B.Sc., Senior Project Manager Email: LPrefontaine@maxxam.ca Phone# (604)639-2616

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

Maxxam ID			SY0380	SY0381	SY0382	SY0383	SY0384	SY0385		
Sampling Date			2018/01/29 00:00	2018/01/29 00:00	2018/01/29 00:00	2018/01/29 00:00	2018/01/29 00:00	2018/01/29 00:00		
COC Number			546212-05-01	546212-05-01	546212-05-01	546212-05-01	546212-05-01	546212-05-01		
	UNITS	MAC	GA05-30S	GA06-30S	GA08-30S	GA12-30S	GA13-30S	GA16-30S	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	1.41	0.58	18.8	1.23	2.45	2.17	0.20	8907050
No Fill	No Excee	dance								
Grey Exceeds 1 criteria policy/le			ia policy/level							
Black Exceeds both crite		iteria/levels								
RDL = Reportable Detection	Limit									

Maxxam ID			SY0386	SY0387		SY0388	SY0389	SY0394		
Sampling Date			2018/01/29 00:00	2018/01/29 03:00		2018/01/29 03:00	2018/01/29 03:00	2018/01/29 03:00		
COC Number			546212-05-01	546212-05-01		546212-05-01	546212-05-01	546212-06-01		
	UNITS	MAC	GA20-30S	PA01-30S	QC Batch	PA02-30S	PA03-30S	PA07-30S	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	1.15	3.18	8907050	7.31	2.93	0.79	0.20	8907060
No Fill	No Exceed	dance								
Grey	Exceeds 1	criteri	a policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detect	ion Limit									

Maxxam ID			SY0395	SY0396	SY0397	SY0398	SY0399	SY0400		
Sampling Date			2018/01/29 03:00	2018/01/29 03:00	2018/01/29 03:00	2018/01/29 03:00	2018/01/29	2018/01/29		
COC Number			546212-06-01	546212-06-01	546212-06-01	546212-06-01	546212-06-01	546212-06-01		
	UNITS	MAC	PA11-30S	PA16-30S	PA17-30S	PADUP-30S	SB07-30S	18ST05-30S	RDL	QC Batch
Total Metals by ICPMS	•		•	•	•			•		
Total Lead (Pb)	ug/L	10	0.94	1.86	5.50	5.54	0.65	0.95	0.20	8907060
No Fill	No Excee	dance								
Grey	Exceeds	1 criter	ia policy/level							
Black	Exceeds	ooth cr	iteria/levels							
RDL = Reportable Detec	ction Limit									



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

Maxxam ID			SY0401	SY0402	SY0403	SY0405	SY0406	SY0407		
Sampling Date			2018/01/29	2018/01/29	2018/01/29	2018/01/29	2018/01/29	2018/01/29		
COC Number			546212-06-01	546212-06-01	546212-06-01	546212-07-01	546212-07-01	546212-07-01		
	UNITS	MAC	18ST08-30S	18DC03-30S	18DC04-30S	18DC08-30S	18DC09-30S	18DC13-30S	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	1.29	1.19	1.23	6.09	1.23	3.31	0.20	8907060
No Fill										
Grey	Exceeds 2	L criter	ia policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detection	n Limit									



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

Maxxam ID				SY0408	SY0409	SY0410		
Sampling Date				2018/01/29	2018/01/29	2018/01/29		
COC Number				546212-07-01	546212-07-01	546212-07-01		
		UNITS	MAC	18DC17-30S	18DC18-30S	18DC20-30S	RDL	QC Batch
Total Metals by ICPMS								
Total Lead (Pb)		ug/L	10	4.38	4.91	13.3	0.20	8907060
No Fill	No Exceed	dance	•		•		=	•
Grey	Exceeds 1	criteria	policy	/level				
Black	Exceeds b	oth crit	eria/le	vels				
RDL = Reportable Detection Limit								



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

### **GENERAL COMMENTS**

Each temperature is the average of up to three cooler temperatures taken at receipt

Package 1	8.7°C
-----------	-------

MAC: The guidelines that have been included in this report have been taken from the Canadian Drinking Water Quality Summary Table, February 2017.

Criteria A = Maximum Acceptable Concentration (MAC) / Criteria B = Aesthetic Objectives (AO) / Criteria C = Operational Guidance Values (OG) It is recommended to consult these guidelines when interpreting your data since there are non-numerical guidelines that are not included on this report.

### Turbidity Guidelines:

- 1. Chemically assisted filtration: less than or equal to 0.3 NTU in 95% of the measurements or 95% of the time each month. Shall not exceed 1.0 NTU at any time.
- 2. Slow sand / diatomaceous earth filtration: less than or equal to 1.0 NTU in 95% of the measurements or 95% of the time each month. Shall not exceed 3.0 NTU at any time.
- 3. Membrane filtration: less than or equal to 0.1 NTU in 99% of the measurements made or at least 99% of the time each calendar month. Shall not exceed 0.3 NTU at any time.

Results relate only to the items tested.



### **QUALITY ASSURANCE REPORT**

TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01

Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

		Matrix	Spike	Spiked	Blank	Method B	lank	RPD		
QC Batch	Parameter	Date	% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits
8907050	Total Lead (Pb)	2018/02/09	96	80 - 120	98	80 - 120	<0.20	ug/L	9.0	20
8907060	Total Lead (Pb)	2018/02/10	104	80 - 120	95	80 - 120	<0.20	ug/L	4.7	20

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150-01
Site Location: SD68 LEAD DW TESTING

Sampler Initials: BB

### **VALIDATION SIGNATURE PAGE**

The analytical data and all QC contained in this report were reviewed and validated by the following individual(s).

Rob Reinert, B.Sc., Scientific Specialist

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.

		INVOICE TO:			Report Inform	ition			Project Informat	ion	= _	no mora de suas-cursa suas de Sala Sala Sala Sala Sala Sala Sala Sal	Page ( c
pany Name		A TECH CANADA INC.	Company	Name				Quotation#	B71611 ENW.VENW03150-01			<b>是大学家学</b>	ittle Order#
lact Name	Darren Thom		Contact N	ame Darren Th	omas			P.O. W					10000000
ess	#1 - 4376 BO		Address					Project #				3809848_COC	546212
	NANAIMO BO		00					Project Name	SDEG Lead	où teg	YAL	SASS	Ject Manag
ne	(250) 756-225	66 x Fax: (250) 756-26 as@tetratech.com; EBA.Labdata@	1.110110	D TI		Fax		Site #	5 0 /	6		N HANNA BERMUNDA BARNA BANK BANK BANKA BANKA BANKA BAN	Letitia Prefonta
1		as@tetratech.com, EBA.Labdata@	Limin		omas@tetrate	ch.com; EBA.Labo		Sampled By	ten Burton	/Dames 11	May	C#546212-05-01	
egulatory Cr	teria:	The first of	Spe	cial Instructions			ANALYSIS F	EQUESTED (PLEASE	BE SPECIFIC)			Turnaround Time (TAT) Required Please provide advance notice for rush pro	
CSR CCME BC Wate	tlentth (	and		Kan Kan	illered ? (Y/N)	ing Water					(will be a Standari Please r days - cr	r (Standard) TAT:  applied if Rush TAT is not specified):  d TAT = 5-7 Working days for most tests  note: Standard TAT for contain tests such as BOD and contact your Project Manager for details.  ecific Rush TAT (if applies to entire submission)  2 2 3 2 3 2 3 2 3 2 3 2 4 6 6 6 6 6 6 6 6 6 6 6 6 6 6 6 6 6 6	Dioxins/Furans
LONG OF THE	MPLES MUST BE K	EPT COOL ( < 10°C ) FROM TIME OF SAMP Sample (Location) Identification	LING UNTIL DELIVER	To MAXXAM	Matrix M	Lead - Drinking					2021200	Confirmation Number (call list	for #)
		6A05-305	18/01/29	12: wadnik	t water	X					1		
		GA06-305		Ī	1 h	X					1		
		1-A08-305	1 5		11/	7				0	1		
		(-A1) - 300			1 1	7					1		
		1-A17-300			1	12					1		
		(-A16-30)				L)					1		
		1-A70- 200	++-	1		3					1		
		PAN1 - 300		03:00	T V	7					1		
		PA-27 - 30		1	1	2					1		-
	41	PA 03 - 30.		1	1 1	2					1		
· DEL PAR	JUISHED BY: (Signat	THO 7 WS	(YY/MM/DD) Tir	1	4						- (		
RELING	JUISHED BY: (Signal		Till Fol S	a um	PEDRO -	Y: (Signature/Print)		2018 D 108		rs used and t submitted Time	Setsitive Te	emperature (*C) on Receipt Custody Seel	Intact on Coole

		INVOICE TO:		F4-6	Se-	Repo	rt Inform	ation			Projec	t Information				Page
any Name	the state of the s	A TECH CANADA INC.	C	ompany Nar	ne					Quotation #	B7161					tle Orde
ac Name	Darren Thoma		c	Contact Name	Darren T	homas		<u> </u>		P.O. #						AVS
959	#1 - 4376 BOE		A	ddress						Project #	ENW.VENW03150-01			_ B	8809848_COC	546212
	NANAIMO BC						_	3111		Project Name	SASO	De Lead	test	ns		sct Man
e	(250) 756-225	6 x Fax (250) 756-26 is@tetratech.com; EBA.Labdata@		hone	Dames T			Fax:	abdata@tetratec	Site#	7 1	16.	77			Letitia Prefor
	Monato	isgretialecii.com, EBA Labdatag	gletratec E	mail		nomas@	tetrate	n.com; EBA.L		Sampled By			1 /Aur	621	C#546212-06-01	32 200 STATE
gulatory Cr	teria:			Special	Instructions		-		ANALYSIS	REQUESTED (PLEA	SE BE SPECIF	1 1		_	Turnaround Time (TA	THE LOCAL PROPERTY OF THE PARTY
CSR										1					Please provide advance notice	de for rush projects
CCME									1 1	1 1			1	S. 18	(Standard) TAT:	
CLIME								1 1	1	1 1					oplied if Rush TAT is not specified)	
BC Wate	er Quality						Z			1 1			l .		TAT = 5-7 Working days for most lests	
Other	Health Co	in la	Ν.,				2) (	ě	1 1	1 1	- 1			days - con	ote: Standard TAT for certain tests suci ntact your Project Manager for details.	has BOD and Dioxins/Furar
Olimi	THE UNITED	V					Pe	Wate	1 1	1 1				Job Sper	cific Rush TAT (if applies to entire s	ubmission)
			528 132		77.		- iii	gui		1 1	- 1	1 1		1 DAY	2 Day 3 Day Da	ste Required:
							B	Drinking	1 1	1 1		1 1			onfirmation Number	
SAN	IPLES MUST BE KE	PT COOL ( < 10°C ) FROM TIME OF SAMP	PLING UNTIL D	ELIVERY TO	MAXXAM		1E	1 2 1	4 1	1 1				Ausn Col	minimision Number	(call lab for #)
Sample	Barcode Label	Sample (Location) Identification	Date Sa	molad	Time Sampled	No.	Veta	Lead	1 1	1 1			1	# of Bottles	Con	mments
Ouripin	Outcode Carel	0. 3 0	Date 34	, impose	Time Sampled	Matr	(X   -			+	-		-			
		190+-50c	18/01	19	03:00	Wate	- h	1	1 1	1 1	- 1			1		
		DA II -	1	1-1	1	1	1	1	1-1-					1	<del>                                     </del>	
		PAU - Sisc					W	1+1						(		
		PA16-305	4 3	a 1		1 1		1						1		
		1.110- 20	-	-	_	+	W	(1		+-+			-	- (		
		PA 17- 205	18 1	1		1 1	W	1	1 1	1 1	1			1		
-		AW.OLD D 3			1	1					_			1	+	
		88 PADUP - 305			V	1 1	N	1 X I								
		5007-305				$\top$	1.,	V						1		
_		3001-505	_				~	7						(		
	- 1	18 505 - 205	1 1				N	1		1 1		1 1		1		
		10 303 ~3	-	-		++	- 1	1	+		_		-	,	<del></del>	
		18 STO8-305	4				W	17						(		
		18 N AT 2				+		1						1		
		18 DCO3 - 305					n	1						(		
		18 DC 04 - 305	1	<i>y</i>				X						1		
DEL MAN	URUED DV. (E)					- 0	~	- 1				-	1	1		
RELINQ	UISHED BY: (Signatu		(DOMMIYY)	Time	11111	FIN		Y: (Signature/Print		SOISION OF		# jars used and not submitted		stive	Lab Use Only	Custody Seal Intact on Coole
		I LUMBER IN MIGHT LD	106101	10.00	1 Luu	/HTI	NU.	mun.		וח זיירווסוריאי		10	10000000	Ten	9.8.9	Juniory Seat Institute on Cook

		INVOICE TO:				Report Inf	ormat	ion		Proje	et Information			ALMANDATUM CALC.	III <b>= 1</b> 0	
Company Hame #	1433 TETR	A TECH CANADA INC.		Company Name		tar			Quotation#	B716	11		100			ttle Order#:
AND DESTRUCTION OF THE PARTY OF	arren Thoma	and the state of t		Contact Name	Darren Tho	mas		-8 4/1	P.O.#	-				848_COC	16.00	1111111111111
ADUI ODA	1 - 4376 BOE			Address			_		Project #		VENW03150-01		Double	040_000		545212
200	ANAIMO BC		re 2000				_		Project Name	308.20	Ow load -	office	501 57000			ect Manager
THOUSE TO	250) 756-225	6 x Fax (250) 7		Phone	Dawn The		-to-ot	Fax n.com; EBA.Labdata@tetra	Site #	0	0/1	ven That			1   6	etitia Prefontaina
		is@tetratech.com; EBA Lab	data@tetratec	Email		mas@tetr	ateci		- Jan Pan Di	Ala		VER INDIAN	2)	C#548212-07-01	T. D	
Regulatory Criteria	a.			Special I	nstructions		1	ANALY	SIS REQUESTED (PLEA	SE BE SPEC	(FRG)			Turnaround Time (TA		
CSR		11378					П		1 1					Please provide advance notic	e for rush proje	.115
=		2040	- 11						1 1			100	egular (Standan			LZ
CCME			- 1						1 1			1.71		Rush TAT is not specified):		لا
BC Water Qu	uality						Z		1 1			103		7 Working days for most tests		
	Keeth La		18				/ \ ) < pa	<u>ā</u>	1 1	- 1				dard TAT for certain tests suct or Project Manager for details.	as BOD and D	cxins/r-urans are -
Other #	usin Ca	NEON	V.				ed 2	Water	1 1	-			ob Specific Rus	sh TAT (if applies to entire s	ubmission)	
							i i	g				١,	DAY 7	Day 3 Day Day	e Required:	
							pia i	Drinking	1 1	1			lush Confirmatio	n Nimber		
SAMPLE	ES MUST BE KE	PT COOL ( < 10°C ) FROM TIME O	F SAMPLING UNTI	DELIVERY TO	MAXXAM		15		1 1				ast Commission	T) Marbos	(call lab for	(#)
Sample Bar	rode I shel	Sample (Location) Identifical	ion Dete	Sampled	Time Sampled	Matrix	Meta	Lead	1 1			#1	of Bottles	Con	nments	
dample dar	Code Caber			Sampled	I me Sampred	Macrix	-	7 1 1	-	-	-	-	,			
		18 DC08-30	s IK	2/29		water	N	7	1 1				1			
8			100000	1		i							,			
		180009 - 30					W	+					1			
		180013-30					1	1-					1			
-		79302 VC		1				7		_		-	-		_	
		18 DC 17 - 30	25	1 1			W	+	1 1	- 1		10	1			
										-			,			
		180018-3	25				N	+					(			
		1800-20-30	2.				/						1			
-						11.	-	$\sim$		-	+	-	-			
	)	18 STO9 -30	, \			V	N						1			
		.,	_				Ť						-	÷		
(A)				1												
							H						_			
													3			
RELINQUISI	HED BY; (Signatu	re/Print)	Date; (YY/MM/DD	Time	T	RECEN	VED BY	f: (Signature/Print)	Date: (YY/MM/DC					Lab Use Only		
1	- Dame	in Thomas	18/02/07	مد:(ا	11111	PEDRO	7	ACK	201810210	8 08	not submitted	Time Sensitiv	1 emperature		Sustody Seel Int	act on Cooler?
		985—785 N/200_5===================================	CATHALIST AND AND	_	100		100			Aug Clasers	- 55-5		9.8	Ra	Yes	No A )NA



Your Project #: ENW.VENW03150
Site Location: SD68 DW TESTING

**Attention: Ben Barton** 

TETRA TECH CANADA INC. #1 - 4376 BOBAN DRIVE NANAIMO, BC Canada V9T 6A7

Your C.O.C. #: 545893-11-01, 545893-12-01, 545893-13-01, 545893-14-01, 545893-15-01

Report Date: 2018/02/06 Report #: R2510628

Version: 1 - Final

### **CERTIFICATE OF ANALYSIS**

MAXXAM JOB #: B807281 Received: 2018/01/30, 08:48

Sample Matrix: DRINKING WATER

# Samples Received: 47

		Date	Date		
Analyses	Quantity	y Extracted	Analyzed	<b>Laboratory Method</b>	Analytical Method
Elements by CRC ICPMS (total)	38	N/A	2018/01/31	BBY7SOP-00003,	EPA 6020b R2 m
Elements by CRC ICPMS (total)	9	N/A	2018/02/02	2 BBY7SOP-00003,	EPA 6020b R2 m

#### Remarks:

Maxxam Analytics' laboratories are accredited to ISO/IEC 17025:2005 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Maxxam are based upon recognized Provincial, Federal or US method compendia such as CCME, MDDELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Maxxam's profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Maxxam in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected.

Maxxam Analytics' liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Maxxam has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Maxxam, unless otherwise agreed in writing.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

\* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.



Your Project #: ENW.VENW03150
Site Location: SD68 DW TESTING

**Attention: Ben Barton** 

TETRA TECH CANADA INC. #1 - 4376 BOBAN DRIVE NANAIMO, BC Canada V9T 6A7

Your C.O.C. #: 545893-11-01, 545893-12-01, 545893-13-01, 545893-14-01, 545893-15-01

Report Date: 2018/02/06 Report #: R2510628

Version: 1 - Final

## **CERTIFICATE OF ANALYSIS**

MAXXAM JOB #: B807281 Received: 2018/01/30, 08:48

**Encryption Key** 

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150 Site Location: SD68 DW TESTING

Sampler Initials: DT

Maxxam ID			SW7411	SW7412	SW7413	SW7414	SW7415	SW7416		
Sampling Date			2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00		
COC Number			545893-11-01	545893-11-01	545893-11-01	545893-11-01	545893-11-01	545893-11-01		
	UNITS	MAC	GA01-OS	GA02-OS	GA03-OS	GA04-OS	GA05-OS	GA06-OS	RDL	QC Batch
Total Metals by ICPMS	·	-	<u> </u>	•	•		•	•		
Total Lead (Pb)	ug/L	10	6.98	3.76	1.11	7.51	15.8	11.1	0.20	8898737
No Fill	No Excee	dance								
Grey	Exceeds 1	criter	ia policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detection Limit										

Maxxam ID			SW7417	SW7418	SW7419	SW7420	SW7421	SW7422		
Sampling Date			2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00		
COC Number			545893-11-01	545893-11-01	545893-11-01	545893-11-01	545893-12-01	545893-12-01		
	UNITS	MAC	GA07-OS	GA08-OS	GA09-OS	GA10-OS	GA11-OS	GA12-OS	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	6.08	20.7	4.67	0.50	6.46	10.7	0.20	8898737
No Fill	No Excee	dance								
Grey	Exceeds 2	L criter	ia policy/level							
Black	Exceeds b	oth cr	iteria/levels							
RDL = Reportable Detectio	n Limit									

RD	L =	Reporta	ble [	etect	ion I	_imi1
----	-----	---------	-------	-------	-------	-------

-										
Maxxam ID			SW7423	SW7424	SW7425	SW7426	SW7427	SW7428		
Sampling Date			2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00	2018/01/28 12:00		
COC Number			545893-12-01	545893-12-01	545893-12-01	545893-12-01	545893-12-01	545893-12-01		
	UNITS	MAC	GA13-OS	GA14-OS	GA15-OS	GA16-OS	GA17-OS	GA18-OS	RDL	QC Batch
Total Metals by ICPMS	·		-		·	-	•	•		-
Total Lead (Pb)	ug/L	10	12.5	8.13	7.87	13.2	0.55	1.59	0.20	8898737
No Fill	No Excee	dance								
Grey	Exceeds :	1 criter	ia policy/level							
Black	Exceeds l	both cr	iteria/levels							
RDL = Reportable Dete	ction Limit									



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150 Site Location: SD68 DW TESTING

Sampler Initials: DT

Maxxam ID			SW7429		SW7430	SW7439	SW7440	SW7441		
Sampling Date			2018/01/28		2018/01/28	2018/01/28	2018/01/28	2018/01/28		
Sampling Date			12:00		12:00	12:00	03:00	03:00		
COC Number			545893-12-01		545893-12-01	545893-13-01	545893-13-01	545893-13-01		
	UNITS	MAC	GA19-OS	QC Batch	GA20-OS	GADUP-OS	PA01-OS	PA02-OS	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	8.22	8898737	9.32	8.78	13.7	17.3	0.20	8898755
No Fill	No Exceed	lance							-	
Grey	Exceeds 1	criteri	a policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detection Limit										



RDL = Reportable Detection Limit

Maxxam Job #: B807281 Report Date: 2018/02/06 TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150
Site Location: SD68 DW TESTING

Sampler Initials: DT

Maxxam ID			SW7442	SW7443	SW7444	SW7445	SW7446	SW7447		
Sampling Date			2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00		
COC Number			545893-13-01	545893-13-01	545893-13-01	545893-13-01	545893-13-01	545893-13-01		
	UNITS	MAC	PA03-OS	PA04-OS	PA05-OS	PA06-OS	PA07-OS	PA08-OS	RDL	QC Batch
Total Metals by ICPMS		•		•	•	•	•	•		
Total Lead (Pb)	ug/L	10	18.7	6.60	1.20	1.41	15.0	4.33	0.20	8898755
No Fill	No Excee	dance								
Grey	Exceeds 1	criter	ia policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detection Limit										

Maxxam ID			SW7448	SW7449	SW7450	SW7451	SW7452	SW7453		
Sampling Date			2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00	2018/01/28 03:00		
COC Number			545893-13-01	545893-14-01	545893-14-01	545893-14-01	545893-14-01	545893-14-01		
	UNITS	MAC	PA09-OS	PA10-OS	PA11-OS	PA12-OS	PA13-OS	PA14-OS	RDL	QC Batch
Total Metals by ICPMS										
Total Wietais by ICPIVIS										
Total Lead (Pb)	ug/L	10	3.75	1.03	30.2	3.29	3.07	4.19	0.20	8898755
•	ug/L No Excee		3.75	1.03	30.2	3.29	3.07	4.19	0.20	8898755
Total Lead (Pb)	No Excee	dance	3.75	1.03	30.2	3.29	3.07	4.19	0.20	8898755

		l .							1	
Maxxam ID			SW7454	SW7455	SW7456		SW7457	SW7458		
Sampling Date			2018/01/28	2018/01/28	2018/01/28		2018/01/28	2018/01/28		
Sampling Date			03:00	03:00	03:00		03:00	05:00		
COC Number			545893-14-01	545893-14-01	545893-14-01		545893-14-01	545893-14-01		
	UNITS	MAC	PA15-OS	PA16-OS	PA17-OS	QC Batch	PADUP-OS	SB01-OS	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	5.69	17.2	65.1	8898755	49.3	6.68	0.20	8898774
No Fill	No Exceed	dance								
Grey	Exceeds 1	criteri	a policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detection Limit										



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150 Site Location: SD68 DW TESTING

Sampler Initials: DT

Maxxam ID			SW7460	SW7461	SW7462	SW7463	SW7464	SW7465		
Sampling Date			2018/01/28	2018/01/28	2018/01/28	2018/01/28	2018/01/28	2018/01/28		
Sampling Date			05:00	05:00	05:00	05:00	05:00	05:00		
COC Number			545893-15-01	545893-15-01	545893-15-01	545893-15-01	545893-15-01	545893-15-01		
	UNITS	MAC	SB02-OS	SB03-OS	SB04-OS	SB05-OS	SB06-OS	SB07-OS	RDL	QC Batch
Total Metals by ICPMS										
Total Lead (Pb)	ug/L	10	8.70	4.34	0.47	2.89	0.42	10.8	0.20	8898774
No Fill	No Excee	dance	•						-	
Grey	Exceeds 1	criter	ia policy/level							
Black Exceeds both criteria/levels										
RDL = Reportable Detectio	RDL = Reportable Detection Limit									



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150
Site Location: SD68 DW TESTING

Sampler Initials: DT

Maxxam ID				SW7466		
Sampling Da	ite			2018/01/28 05:00		
COC Numbe	r			545893-15-01		
		UNITS	MAC	SBDUP-OS	RDL	QC Batch
Total Metals	s by ICPMS					
Total Lead (F	Pb)	ug/L	10	0.75	0.20	8898774
No Fill	No Exceedance	<u>;</u>				
Grey	Exceeds 1 crite	ria polic	y/leve	I		
Black	Exceeds both c	riteria/l	evels			
RDL = Repor	table Detection L	imit				



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150
Site Location: SD68 DW TESTING

Sampler Initials: DT

### **GENERAL COMMENTS**

Each temperature is the average of up to three cooler temperatures taken at receipt

Package 1	4.3°C

COC page 5 of 5 line # 6, SB06-OS: 1x 120mL plastic preserved with HNO3 received with incorrect labels. Sample labeled as SB07-OS, inspected as per sample label.

MAC: The guidelines that have been included in this report have been taken from the Canadian Drinking Water Quality Summary Table, February 2017.

Criteria A = Maximum Acceptable Concentration (MAC) / Criteria B = Aesthetic Objectives (AO) / Criteria C = Operational Guidance Values (OG) It is recommended to consult these guidelines when interpreting your data since there are non-numerical guidelines that are not included on this report.

### **Turbidity Guidelines:**

- 1. Chemically assisted filtration: less than or equal to 0.3 NTU in 95% of the measurements or 95% of the time each month. Shall not exceed 1.0 NTU at any time.
- 2. Slow sand / diatomaceous earth filtration: less than or equal to 1.0 NTU in 95% of the measurements or 95% of the time each month. Shall not exceed 3.0 NTU at any time.
- 3. Membrane filtration: less than or equal to 0.1 NTU in 99% of the measurements made or at least 99% of the time each calendar month. Shall not exceed 0.3 NTU at any time.

Results relate only to the items tested.



### **QUALITY ASSURANCE REPORT**

TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150

Site Location: SD68 DW TESTING

Sampler Initials: DT

			Matrix	Spike	Spiked	Blank	Method B	lank	RPI	)
QC Batch	Parameter	Date	% Recovery	QC Limits	% Recovery	QC Limits	Value	UNITS	Value (%)	QC Limits
8898737	Total Lead (Pb)	2018/01/31	97	80 - 120	98	80 - 120	<0.20	ug/L	0.40	20
8898755	Total Lead (Pb)	2018/01/31	99	80 - 120	97	80 - 120	<0.20	ug/L	2.2	20
8898774	Total Lead (Pb)	2018/02/02	93	80 - 120	102	80 - 120	<0.20	ug/L	1.5	20

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.



TETRA TECH CANADA INC.

Client Project #: ENW.VENW03150 Site Location: SD68 DW TESTING

Sampler Initials: DT

### **VALIDATION SIGNATURE PAGE**

The analytical data and all QC contained in this report were reviewed and validated by the following individual(s).

Andy Lu, Ph.D., P.Chem., Scientific Specialist

Maxxam has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per section 5.10.2 of ISO/IEC 17025:2005(E), signing the reports. For Service Group specific validation please refer to the Validation Signature Page.

va y	Maxoam Analytics International Corporation of		Tel:(604) 734 7276	Toll-free 800-563-	6266 Fax:(604) 731 2386 ww	w maxxam ca				Chain Of Custody Recor	u	nd of	
	INVOICE TO:			Report Informa	ition		Project Info	rmation					
onwany Name	#1433 TETRA TECH CANADA INC.	Company Na	me Swy	41 11	wile	Quotation #	B60578			a prostana emperadornamen		ler#:	
ontact Name	Ben Barton #1 - 4376 BOBAN DRIVE	Contact Name		V I I		P.O.#							
Idress	NANAIMO BC V9T 6A7	Address	-			Project #	SA68		/		AN PARAMETERS III	1	
none	(250) 756-2256 x Fax (250) 756-2686 x	Phone	-		Fax:	Project Name	SpeD	DW 1	strag	B807281_C	OC	nager	
nail	bbarton@eba.ca, EBA.Labdata@tetratech.com	Email		40 44		Site # Sampled By	Dive	Mari	as	7		ntaine	
Regulatory Cri	ieria.	Specia	Instructions			ANALYSIS REQUESTED (PLEA	ASE BE SPECIFIC)	7.0,		Turnaround	Time (TAT) Required:		
CSR										Please provide ad-	vance notice for rush projects		
=	HIVE II I						4. 1		R	egular (Standard) TAT:			
CCME	-0.27			30.10	1 1 1					will be applied if Rush TAT is not spe			
BC Wate	r Quality			2					1.00	andard TAT = 5-7 Working days for			
Diner	The Health Com de			7 / 7	Water				da	ease note: Standard TAT for certain nys - contact your Project Manager I	tests such as BOO and Dioxin by details.	ns/Furans are	
Δ	DWQ GL			pa de					3	ob Specific Rush TAT (if applies t	io entire submission)		
				E.	Drinking				1	DAY 2 Day 3 Day	Date Required.		
SAL	PLES MUST BE KEPT COOL ( < 10°C ) FROM TIME OF SAMPLING UP	UTIL DELEVERY TO	O MAYYAM	T T	i D	1 1 1			В	lush Confirmation Number:			
200	Control Contro	THE DELIVER !	U MIAAAMII	9	- Pead	1 1 1	1 1	1	#0	of Bottles	(call lab for #) Comments		
Sample	Barcode Label Sample (Location) Identification D	late Sampled	Time Sampled	Matrix S	3				3.5				
GA	01-95 (SAU1-U) 10	61/28	12:00gm	Lot N						<b>V</b>			
GAG	2 0 0	i		1	+		31:			1			
GA	03 +03 GAD3-05			N	2					( )			
(5A)	04-05 GA04-05	7		W	1					(			
(sA	05-0 (ADS-DE			1	2					(			
1-4	86-Q (ABB-D)			W	\$			-		(			
(-A	27-20 1-427-00			W			$\neg$			ı			
C- 1	A 2 (114 D		-			+ + + + + + + + + + + + + + + + + + + +	11	+-		1			
CA.	0 8 (109-0	1	+	1 N	2					(			
5/10	M-45 GAD1-05		1	N	()					,			
GA	6-03 6A6-03	$\vee$	V	VN	X			-		(			
MELING	(UISHED BY: (Signature/Print) Date: (YY/MM/		-	RECEIVED B	Y: (Signature/Print)	Date: (YY/MM/DD	Time	# jars used and not submitted		Lab Us	A STATE OF THE STA		
	- / Daves March 18/01/2	8 9:W		- KOW	MFZ GODA	2017/01/	40 08:48	(2) (3) (4) (4) (4) (4) (4) (4) (4) (4) (4) (4	Time Sensitive	Temperature (°C) on Receipt	Custody Seal Intact of		
UNLESS OTH	RWISE AGREED TO IN WRITING, WORK SUBMITTED ON THIS CHAIN OF C	SUSTODY IS SHIRLIF	CT TO MAXXAM'S ST	TANDARD TERMS	AND CONDITIONS SIGNING O	E THIS CHAIN OF CUSTODY DO	CUMENT IS ACKNOW	EDOMENT AND A	CCERTANCE	1 11 - 1 1		No Yellow: Cher	
OR MEMBER	AT WWW.MAXXAM.CA/TERMS.			Transporter retroits	AND SCHOOL FIGURE SHOWING C	THE STATE OF COSTODY BO	COMESTI A POSITOR	EDOMEST NIED A	CHEP IMMUE U	A CON TERMS WHICH ARE AVAILAB	SLE VERSIE MEXICAL	Total Series	

	grade 100 -	INVOICE TO:	oy, oncen columbia	Careda VSG 18	5 Tel (504) 734		_	5296 Fax (604) 731 2386 www.	maxxam.ca	750113755		241			18982 pt
	#1433 TETR	A TECH CANADA INC.		The section is	0016		t Informat		7	Project B60578	Information		_		rder#:
ntact Name	Ben Barton			Contact Na		abe as	- 4	water to	Quotation#	B00378					III III
dress	#1 - 4376 BOE	Address	1275 TOTAL TOTAL				P.O. #	ENW.V	ENW03150	502011919555	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1				
	NANAIMO BC								Project Name	5068	s heats	teding			anager
one	(250) 756-225		756-2686 x	Phone	17	100		Fax:	Site # Sampled By	^	- 12	-	B807281_0	COC	'ontaine
ail	bbarton@eba.ca; EBA.Labdata@tetratech.com			Email Special Instructions ANALYSIS						EASE BE SPECIFIC	aver 16114	as	Turnarou		
CSR CCME BC Water	rquality Health Coope	.L Doce					(N/A)	Water					Regular (Standard) TAT: (will be applied if Rush TAT is not it. (Standard TAT = 5-1 Working days Please note: Standard TAT for cer- days - contact your Project Manage	for most lests Isin tests such as BOD and Diox	Ţ
SAN		PT COOL ( < 10°C ) FROM TIME Sample (Location) Identif		NTIL DEUVERY			etals Field Filte	Lead - Drinking W					Job Specific Rush TAT (if applied to 1 DAY 2 Day 3 D Rush Confirmation Number:	Secretary of the second	_[
Saisba	Delicos Cabel	(-A11 ->		5/0/28	Time Sample			1					(		
		GAN-O		101/28	Diwa	hogh	r IV	1	+			$\vdash$	,		
		CA12-0	3	+	- 1	+	1		+++						
		CA15-0	2	-	1	$-\Box$	_	7		-		-	(		
		6A14-6	D <sub>s</sub>				N								
		GA (5 -	05				W	(X)							
		GA16-0	00				V	×					(	-	
		(-A17-0	Os				W	7					(		
		(-A-18-0	De			$\exists t$	~	X					( )		
		(-A 19-1	2,	1		+		7					(		
_		(42-	2	<del>)</del>	1	1	1	8		-1			•		_
A 001 NC	OUISHED BY Asignati	CI CO -	Date: (YY/MM	(DD) Tim			· ·	Y: (Signature/Print)			1.00		X L	umitanio	
L	-/Den	es Missel		28 9:0				THE GOLD	2018 01 2	200 Ok 4	# jars used and not submitted	Time Sensiti		Custody Seal Intect	
	EDWISE AGREED TO	IN WRITING WORK SUBMITTED	ON THIS CHAIN OF	CHOTONY IO CLID	ECT TO MAYYA	MIC OTANDADO	TEDME A	AND CONDITIONS. SIGNING OF	THIS CHAIN OF CHETCOV D	OCTIVENT IS ACKN	DINI EDGHENT AND	L L	11 31	total to the	Yellow Clier

VIAX	Xam	Maxxam Analytics Internation 4606 Canada Way, Burnaby,				Toll-free 800-56:	3-6266 Fax (604) 731 :	386 www.maxxam.co	ě				Chain Of C	ustody Record		- 30
		INVOICE TO:				Report Inform	nation			Project Inf	formation	-	T			562 or 7
Considiny Name		TECH CANADA INC.	-1 /	Company Na	no Sur	ar i	nevice to		Quotation #	B60578						ler#:
ontact Name	Ben Barton	AN DONE		Contact Nam			To so out of the control		P.O. #					BUZULAHAN KANDA	THE THE THE THE	188
ddress	#1 - 4376 BOB/ NANAIMO BC	A CONTRACTOR OF THE PARTY OF TH		Address		101			Project #	ENW.VEN		1	-	ASSESS OF	XX 16	nager
hone	(250) 756-2256		756-2686 x	Phone			Fax		Project Name Site #	JUGES	hater Su	yery		07281_CC		nager
mail	bbarton@eba.c	a; EBA.Labdata@tetratec		Email			rax		Sampled By	Dioren	Thomas					ntaine
Regulatory Cri	itena			Specia	I Instructions			ANALYSIS R	EQUESTED (PLEASE	BE SPECIFIC)	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,			Turnaround Tir	me (TAT) Required:	02
CSR			-											Please provide advar	ce notice for rush projects	
						1	1 1		1 1	1 1		F	egular (Standard	) TAT:		_
CCME									1 1			1.0		ush TAT is not specifi		
BC Wate	or Quality	27 12	1			2			1 1	1 1		197		Working days for m		7.5
V Other	Heally Com	de brack				N/A/Cho	Water							ard 1A1 for certain to Project Manager for	sts such as BGD and Dioxins details.	s/Furans are
Z	The same				37.5	To the second	Š		1 1			1	lob Specific Rus	h TAT (if applies to	entire submission)	- Cal
						ā	Drinking		1 1	1 1			DAY 20	ay 3 Day	Date Required:	
	NO. CO MUST BE KEE	PT COOL ( < 10°C ) FROM TIME (	OF CAMPI INC. 1111	en per menu s		100	<del> </del>			1 1			Rush Confirmation	Number:		
SA	AFLES MOST BE KEN	T COOL ( T TO ) PROM TIME (	JF SAMPLING UN	ILUELIVER!	O MAXXAM	900	1 2	1 1	1 1	1 1			of Bottles		(call lab for #) Comments	
Sample	Barcode Label	Sample (Location) Identifica	ation Da	te Sampled	Time Sampled	Matrix S	9								33111174174	
		GARP-C	2, 18	a/28	12:00an	water w							(			
t i		PA 01 - 0	25		3:wan	1 /	1						1			
		PAO2-0	25		1	1 h	X				-		(			
		PA03 - 0	25			h	17						(			U.
		PA04-0	25			1	X	( )					ı			
		PA05 - C	>			1							(			
		PA06-0	2		-1-					11	1		(			
		PA-27-0	2.			1	X						(			
		PA 08- 0	)c			12	17						(			
0		PA 109-0	><	V	1	Lh	1						1			
* RELING	DUISHED BY: (5ignatur	re(Print)	Date: (YY/MM/D	D) Time		RECEIVED	BY: (Signature/Print)		Date <sub>1</sub> (YY/MM/DD)	Time	# jars used and		V	Lab Use (	) mile	
1	/\	hora Rosert	18/01/28	9:00	~	- Ray	and the second of the second o	X	9k/0130	08:41	not submitted	Time Sensitiv	Tempegature	(°C) on Receipt	Custody Seal Intact or	n Cooler?
	/2	., ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,				,		"		1.4			4,0	5.4	Yes X N	No

100- YEC

Control Control	INVOICE TO:			Report Info	mation			Project In	formation	-		Page		
my 1	TETRA TECH CANADA INC.	Company	Name C	du_ 45 /		4	Quotation #	B60578		1111		er A		
Name Ben Ba		Contact No		400> (	Lanc.	70	P.O.#		- 1 - E-e-					
#1 - 43	76 BOBAN DRIVE	Address			i de la companya della companya della companya de la companya della companya dell		Project #	ENW.VE		224		Į.		
to the latest the late	MO BC V9T 6A7		1000		27	112	Project Name	SMS	DN Soup	ins		nag		
	56-2256 x Fax: (250) 756-2686 n@eba.ca; EBA.Labdata@tetratech.com	110 000 000 000	-		Fax: _		Site #	COLUMN TO THE REAL PROPERTY.	·n		B807281_COC	nta		
	n@eba.ca; EbA.Labdata@tetratech.com	Email	any end seasons			-	Sampled By	Chrie	Moders			-		
ulatory Criteria:		Spe	cial Instructions		-	ANA	LYSIS REQUESTED (PLE	ASE BE SPECIFIC)			Turnaround Time (TAT) Required: Please provide advance notice for rush projects	_		
CSR	70								1 1	PROMINENTS.				
CCME										0.000	(Standard) TAT:  oplied if Rush TAT is not specified):			
					=				1 1	1779 CTTT-0.00	TAT = 5-7 Working days for most tests.			
BC Water Quality	14 ( 1 )				rater	k (4) 2		1 1	1 1	Please no	ote: Standard TAT for certain tests such as BOD and Dioxi	ns/Furan		
Other Keal	I Cand Diebe				Water						ntact your Project Manager for details.	www.1001/00		
		715	100		lene V D				1 1		cific Rush TAT (if applies to entire submission)			
					Field Filter Drinking					1 DAY	2 Day 3 Day Date Required:			
SAMPLES MU	ST BE KEPT COOL ( < 10°C ) FROM TIME OF SAMPLIN	G UNTIL DELIVERY	TO MAXXAM		E 5			- 1 1		Rush Cor	ritimation Number:			
1-1				7.25	Metals	1 1 1		1 1	1 1	# of Bottler	(cell lab for #)  Comments	_		
Sample Barcode L	abel Sample (Location) Identification	Date Sampled	Time Sampled	7	Fe Me		$\rightarrow$		-					
	PA 10-05	18/01/28	osiwa	water	vX					1	8:			
	PA 11 - 23	1		1	12					(				
	DA-12 - 24			111	1			1		(				
	TH (Z US			11										
	PA 13- 0s			1	14		-			(				
	PA 14 - De			111	uX					11				
	PA 15 - 12.				12					(				
	PAIL - De				18					1		7 6		
	111000		1	11	1					1				
	PAIT-US			+11	1					1		_		
	PAR DUP - OS		V	11	1					(				
	SB61-0	A	S:wan	V	ďХ					(				
RELINQUISHED B	Y: (Signature/Print) Date: (YY			RECEIVE	D BY: (Signatu	GOX	Date: (YV/MM/DC	) Time	# jars used and not submitted	-	Lab Use Only			
60	/ Davier /AUMAS 18/01	18 9:0	0 <<	_ 10V	lwa.	GUA	2018/61/2	30 84	TimeSe	ristove Tem	nperature (°C) on Receipt Custody Seel Intect o	on Coaler No		

		INVOICE TO:	-	Report Inform	tion ,		1	Project Info	rmation		Dag		
nir Nama	71433 TETR	A TECH CANADA INC.	Company N	Sens	as hus	u Jo	7	Quotation #	B60578			-	d
Name	Ben Barton		Contact Na		The same			P.O.#				MINI BILL IN CONTRACTOR AND BUILDING	enn i
8	#1 - 4376 BOE	BAN DRIVE	Address	a the second				Project #	ENW.VEN	W03150			23
	NANAIMO BC							Project Name	5068	DU 2	upling	DOOGLOUS HALL HE WAS A STATE OF THE PARTY OF	
	(250) 756-225	The second secon	5 X Phone			Fax:		Site #	_^	- 0	, ~	B807281_COC	'or
	bbarton@eba.	ca; EBA.Labdata@tetratech.com	Email	-				Sampled By	Ulme	Morras			
latory Cri	teria:	the same state of	Spec	al Instructions			ANALYSIS	REQUESTED (PLEA	ASE BE SPECIFIC)			Turnaround Time (TAT) Rec	uired:
CSR		2778158911										Please provide advance notice for ru	sh projects
					L.		1 1		1 1	1 1	Regu	dar (Standard) TAT:	
CCME										1 1	(will b	e applied if Rush TAT is not specified):	
BC Wate	er Quality				î				1 1	1 1	Stand	dard TAT = 5-7 Working days for most tests.	
Other	Kooth Con	d wacc			(N/X) 4 pe	Drinking Water						ie note: Standard TAT for certain tests such as BO - contact your Project Manager for details	D and Dioxins/Fura
W. HOCON					pared	3	1 1	1 1	1 1		Job	Specific Rush TAT (If applies to entire submiss	ion)
					量	, iż	1 1				1 DA	Y 2 Day 3 Day Date Requi	red.
339					9	占	1 1		1 1	1 1	Rush	Confirmation Number:	
SAI	MPLES MUST BE KE	EPT COOL ( < 10°C ) FROM TIME OF SAMPLI	NG UNTIL DELIVERY	TO MAXXAM	98		1 1		1 1				il lab for #)
Sample	Barcode Label	Sample (Location) Identification	Date Sampled	Time Sampled	Matrix S	Lead	1 1		1 1		# of B	Comments	
		SB02-0,	1861/28	Sowan	Late N	X					1		
		SBD3-05	)	1	112	X					(		X 15 18
		SB04-05			1	X					(		
		SB05-05			~	X					(		
	(2	SB06-05			1	+					(		
		SB06-05		1	1	+					ſ		
		SBDUP-OS	V	V	V	X					(		
RELIN	QUISHED BY: (Signati		Y/MM(DD) Time		RECEIVED E	Y: (Signature/Prin		Date: (YY/MM/DD	) Time	# jars used and not submitted		Lab Use Only	
	-/1	James Promer 18/0	128 9:u		= loom	MEL GO	X	2013	W 08:48	and equationed [ ]	ane Sensitive	Temperature (10) on Receipt	es No